

# Curtain Deflector Accessory

## For Use With Packaged Terminal Air Conditioner or Heat Pump

Cancels: New

IHK 84-07-2  
4/15/02

## Installation Instructions

### INTRODUCTION

These instructions cover the installation of the Curtain Deflector Accessory on packaged terminal air conditioning (PTAC) units. See Fig. 1.

The Curtain Deflector is designed to keep window curtains away from the discharge air generated from PTAC units. See Fig. 1.

### PACKAGE CONTENTS

ITEM	QUANTITY
Curtain Deflector	1
Attachment Screws	2

### INSTALLATION

#### **⚠ WARNING**

Disconnect all power to unit to avoid possible electrical shock during installation.

**Step 1** — Disconnect all power to unit.

**Step 2** — Remove front panel from the unit by grasping the panel firmly near the bottom of both sides and pulling forward, then upward to release magnetic latches and partition hooks. See Fig. 2.

**Step 3** — Remove air discharge grille by removing 2 screws on back of front panel. Save screws for later use. See Fig. 3.

**Step 4** — Position discharge grille onto curtain deflector and line up holes.

NOTE: Position discharge grille for desired airflow direction.

**Step 5** — Attach with 2 screws saved in Step 3. See Fig. 4.

**Step 6** — Attach curtain deflector assembly to front cover using 2 screws provided. See Fig. 5-7.

**Step 7** — Replace front panel.

**Step 8** — Restore power to unit.



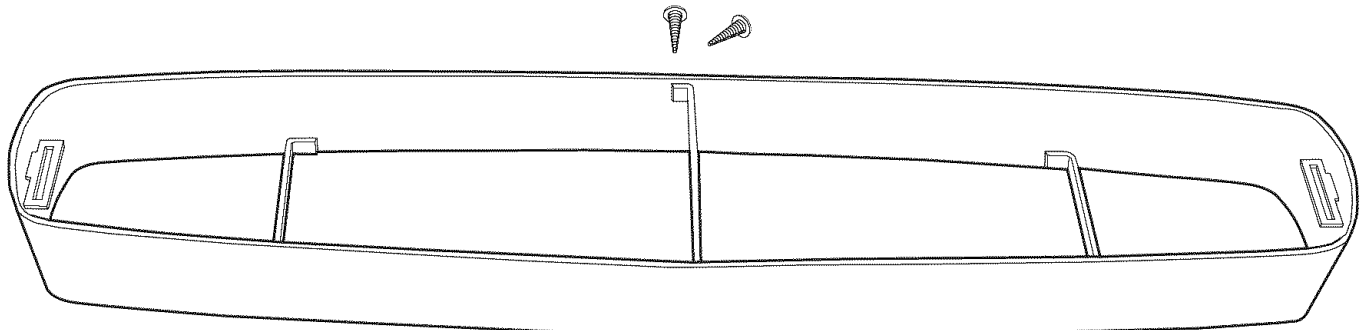



Fig. 1 — Curtain Deflector Accessory

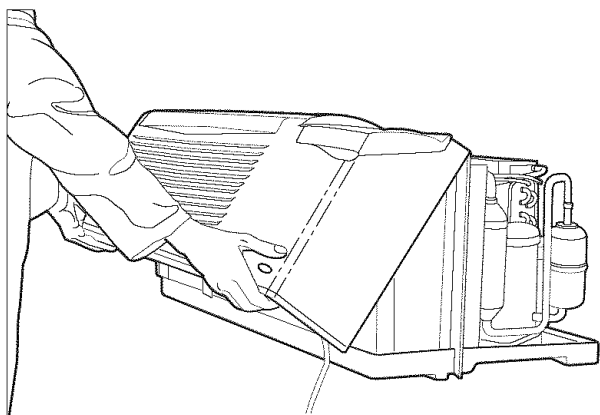


**Fig. 2 — Removing Front Panel**

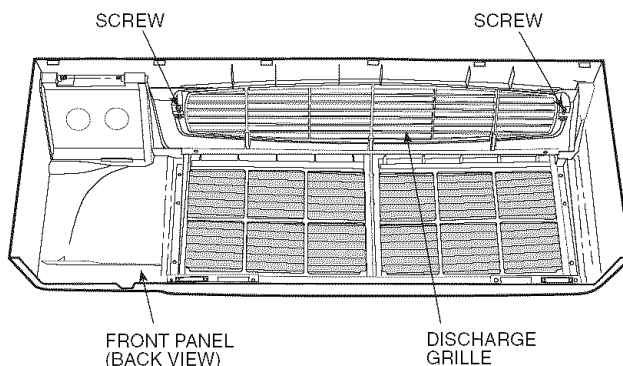


**Fig. 3 — Back View of Front Panel**

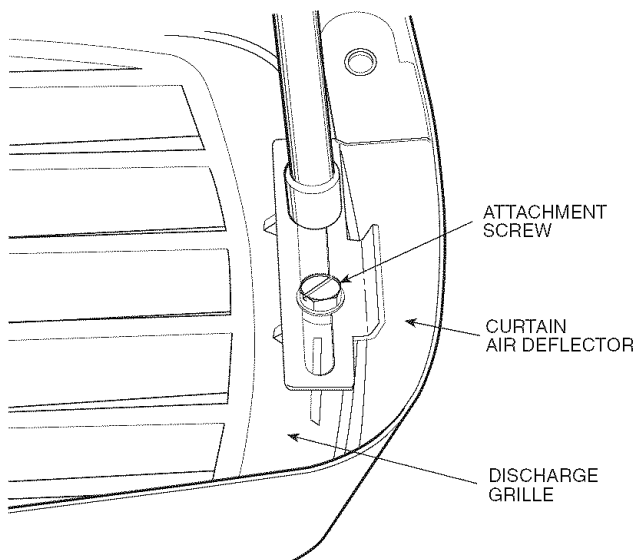


**Fig. 4 — Attaching Discharge Grille to Curtain Deflector with 2 Screws**

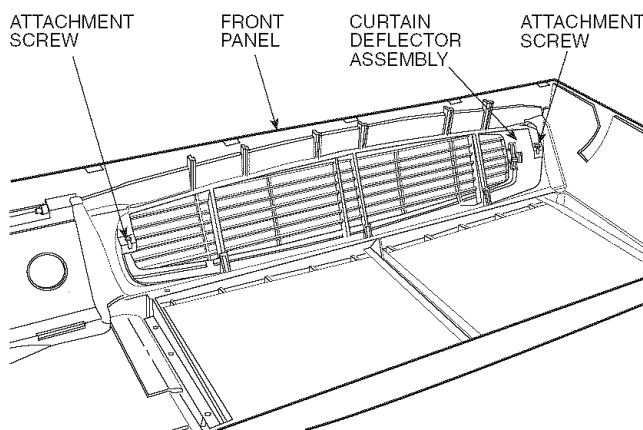

**Fig. 5 — Attaching Curtain Deflector Assembly to Front Panel**

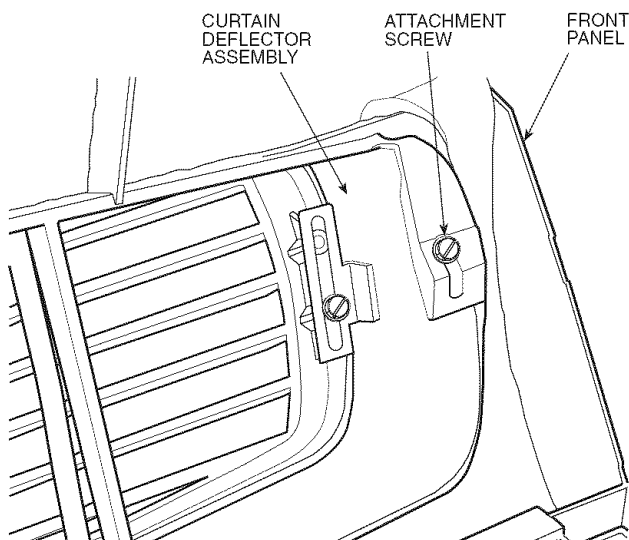

**Fig. 6 — Close-Up of Location of Attachment Screw Attaching Curtain Deflector Assembly to Front Panel**

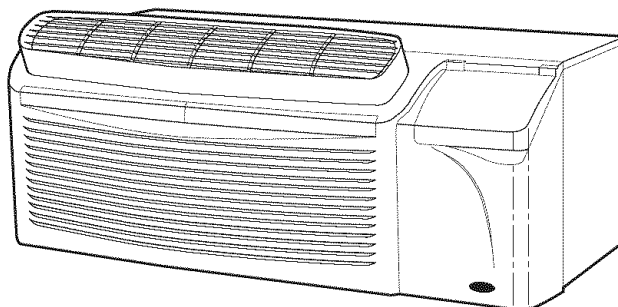

**Fig. 7 — Completed Assembly**